
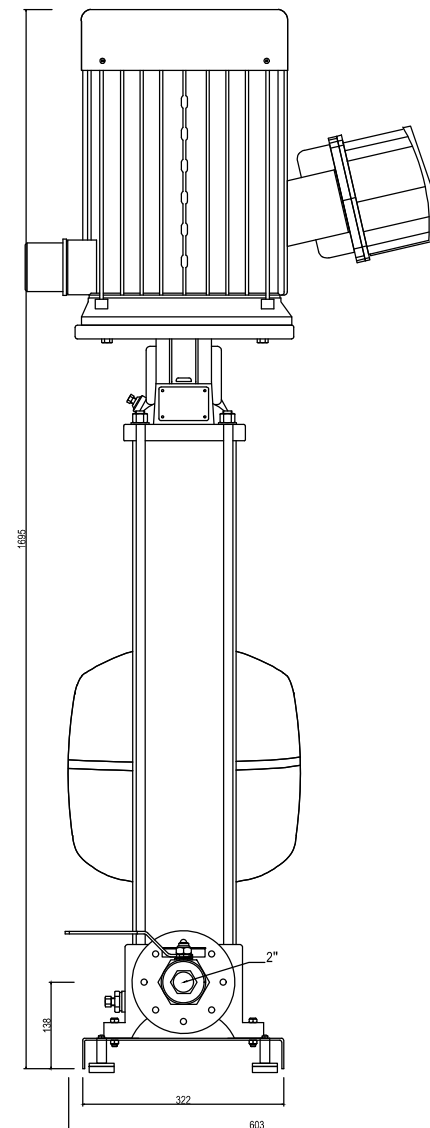


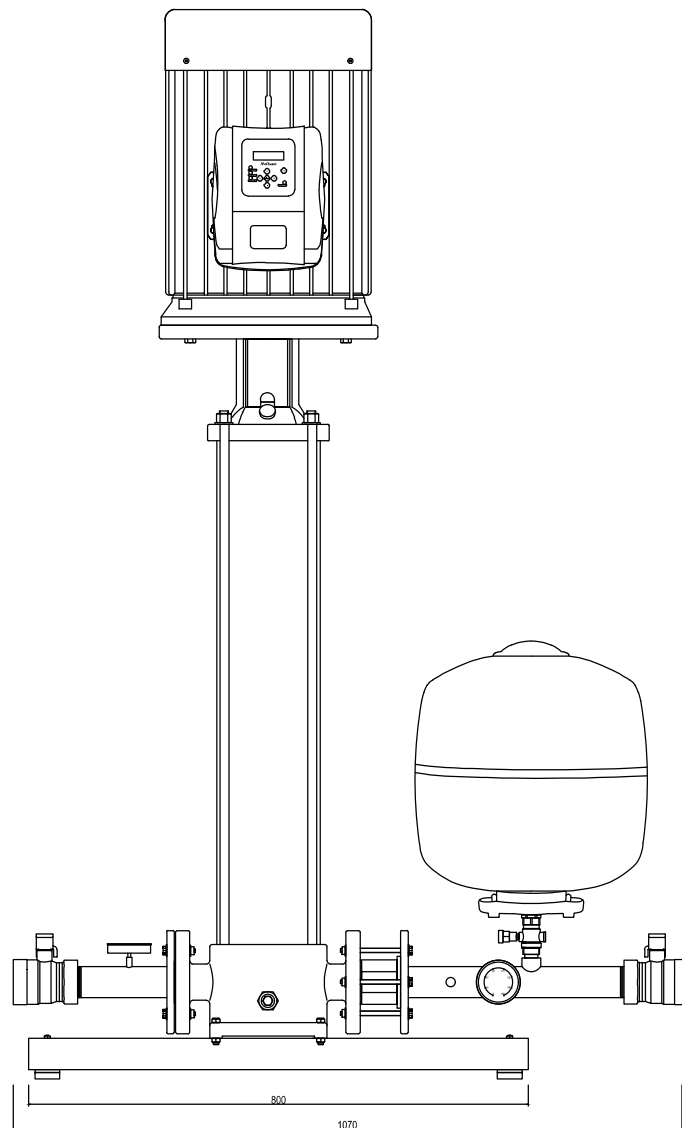

FGJ(DIN-ANSI-JIS) PN16-25-40(DN50) /mm/

**BATS-E CVE 15-17**

PUMPS

13.11.2020

Textilná 3/A

040 12 Košice

